


- NOTES:**
1. ANODE TO BE INSTALLED WITH EVERY SERVICE CONNECTION (STD. DETAIL W-1) ON STEEL MAIN NOT UNDER CATHODIC PROTECTION (SEE ENGINEER).
 2. LEAVE ENOUGH SLACK IN CABLE TO PREVENT DAMAGE DURING BACKFILL OPERATIONS.
 3. ANODE MAY BE INSTALLED HORIZONTALLY IF LOCATED BELOW THE SPRINGLINE OF THE PIPE.

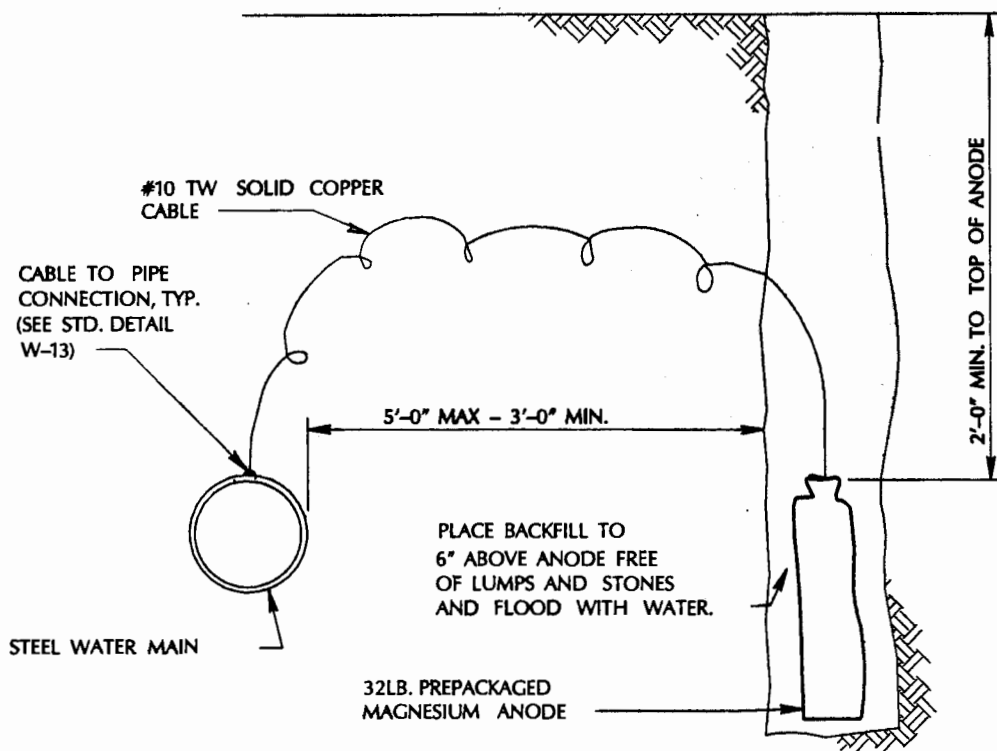

APPROVED BY


Handwritten signature

DATE

Handwritten date: 4-1-90

MAGNESIUM ANODE INSTALLATION

DEPARTMENT OF PUBLIC WORKS



DRAWING
NO.

W-14